

Victron & BSL

Product & System compatibility

The integration with Victron and BSL batteries has been tested, complies with Victron's BMS-Can specification, and is supported by both companies.

Offgrid, Backup and Energy Storage Systems (ESS)

Victron + BSL can be used for the following system types:

- Energy Storage Systems - Self Consumption ([ESS - Start page](#))
- Grid Backup
- Off-grid

Special note for Off-Grid systems

For Off-grid systems, it's strongly recommended to make sure there is a minimum of DC-Coupled PV (= MPPT Solar Charger) in the system. I.e. not only AC-Coupled PV. Also, minimum battery configuration, and factor 1.0 are always important to adhere to, and even more so in case of Off-grid systems. Both BSL and Victron will be reluctant or even refusing to give support to systems that are not sized according to the minimum specified configurations.

A GX device is required, eg Cerbo GX, etc

It is essential to use the BMS-Can (or CAN-bus) connection of a [GX device](#) with the BSL batteries for the keep-alive signal, communication of charge and discharge limits, error codes and state of charge.

The minimum supported firmware version for the [GX device](#) is v2.52. It is recommended to use the latest firmware version on new installations and when troubleshooting issues.

All 48V Multis, MultiPlus, MultiGrids and Quattros are compatible

The minimum supported firmware version is 469. Updating to the latest firmware is recommended for new installations, and troubleshooting issues.

These inverter/charger units must be connected to the [GX device](#) via the VE.Bus connection port.

In grid connected systems, advanced control functions are configurable in the ESS settings on the [GX device](#).

In off-grid systems, the control functions of the BSL Battery Management System (BMS) are built into the latest version of the [GX device](#) using DVCC.

Solar Charger compatibility

All 48V BlueSolar and SmartSolar VE.Direct MPPT Chargers are compatible (*).

Some of our Solar Chargers feature a VE.Direct communication port, some feature a VE.Can communication port, and some feature both. Both of these types of communication ports can be used to connect the Solar charger to the GX Device. Such connection is mandatory, because it is used to regulate charge currents and voltages.

When planning to use the VE.Can communications port to connect the Solar Charger(s), make sure to select a GX Device that has sufficient CAN-Bus ports. The Color Control GX has only one such port, its VE.Can port, and is therefore not suitable. All other GX Devices can be used, since they have two ports. One can then be used to connect the BSL battery, and the other to connect the Solar Charger.

(*) with exception of the models “BlueSolar MPPT 150/70 CAN-bus” and “BlueSolar MPPT 150/85 CAN-bus” which are end-of-life since 2019. Legacy systems, historically installed with this configuration using the allow to charge contacts may be possible, speak to your dealer for more information.

Battery compatibility


The following batteries are supported:

BSL type
B-LFP48-100E
B-LFP48-120E
BSLBATT-5000U

Configuration settings

Integration instructions for Victron and BSL is described in this manual -

[victron_bsl_manual_-_2021-04-14.pdf](#)

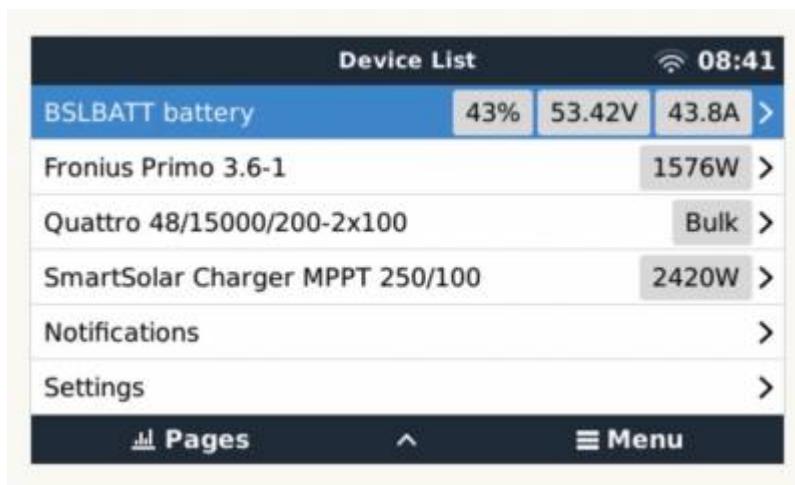

Device		08:42
Connected	Yes	
Connection	CAN-bus	
Product	BSLBATT battery	
Product ID	B021	
Firmware version	v1.0	
VRM instance	512	
Pages		Menu

Device		08:42
Lowest cell voltage	2 ::2	3.334V
Highest cell voltage	1 ::8	3.349V
Minimum cell temperature	3 ::3	24°C
Maximum cell temperature	2 ::1	26°C
Battery modules	3 online	0 offline
Nr. of modules blocking charge / discharge	0	0
Pages		Menu

Further Information

For information about where to buy or find suitably qualified installers, visit the [Where to Buy Page](#).

Further community discussion about installing and using BSL and Victron can be found at [Victron Community](#), use the topic label 'BSL'.

From:
<https://www.victronenergy.com/live/> - **Victron Energy**

Permanent link:
https://www.victronenergy.com/live/battery_compatibility:bsl?rev=1618400950

Last update: **2021-04-14 13:49**

