

# Victron & Redflow ZBM

<http://www.redflow.com/>

## Compatible Victron products

- All 48V Multis and Quattros.
- All 48V solar chargers
- Adding a Color Control GX is recommended but not required

## Charge profile

See the information for the Redflow ZCell at


[https://www.victronenergy.com/live/battery\\_compatibility:redflow\\_zcell](https://www.victronenergy.com/live/battery_compatibility:redflow_zcell)

## Color Control GX

Redflow ZBM batteries can be directly interfaced to the CCGX for monitoring and control (see below).

Alternatively one or more ZBM batteries can be used with the Redflow/ZCell Battery Management System (BMS). That results in keeping all ZBM specific information and control inside the BMS and sending only general summary data (such as system State of Charge) up to the CCGX using a TCP/IP connection. See the Redflow ZCell page at the link above for more information.

For the direct-attach option, the Color Control GX has built in support for directly attaching to one or more Redflow ZBM batteries using the built in Modbus connection and protocol.

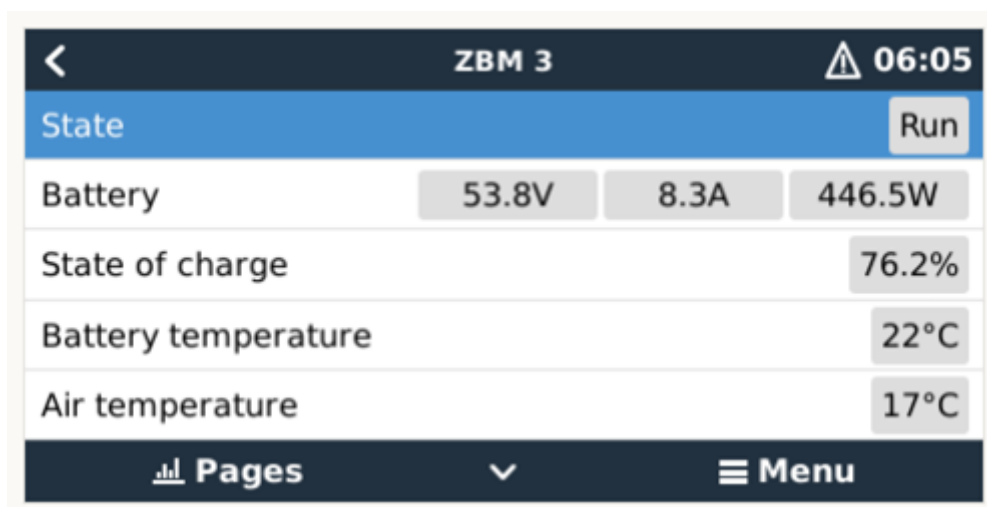

The screenshot shows the Victron Color Control GX interface for a ZBM 3 battery. The top bar displays a back arrow, 'ZBM 3', and a warning icon with the time '06:05'. Below this, a 'State' bar is highlighted in blue with a 'Run' button. The main display area shows four rows of data: 'Battery' with values 53.8V, 8.3A, and 446.5W; 'State of charge' with 76.2%; 'Battery temperature' with 22°C; and 'Air temperature' with 17°C. The bottom bar contains a 'Pages' icon, a dropdown arrow, and a 'Menu' icon.

<	ZBM 3	⚠ 06:05
State		
Battery	53.8V	8.3A 446.5W
State of charge	76.2%	
Battery temperature	22°C	
Air temperature	17°C	
Pages	▼	Menu

1. Connect the CCGX to each battery in the system via Modbus-RS485, (our RS485 to USB interface is needed for that, ASS0305700xx).
2. Monitoring the battery: battery voltage, current, state of charge, temperature and many more ZBM specific alarms and flags.

3. Control the battery: set it to run mode, initiate a maintenance cycle, clear the alarms and more.
4. Configure the battery: the CCGX will automatically assign a unique Modbus address to each battery. Just make sure to connect them, slowly, one by one. After connecting one, wait for it to show up on the CCGX, and then connect the next one. Additionally, it is possible to manually change the Modbus address of the battery.

## DISQUS

~~DISQUS~~

From:  
<https://www.victronenergy.com/live/> - **Victron Energy**

Permanent link:  
[https://www.victronenergy.com/live/battery\\_compatibility:redflow\\_zbm?rev=1548148578](https://www.victronenergy.com/live/battery_compatibility:redflow_zbm?rev=1548148578)

Last update: **2019-01-22 10:16**

