

MultiPlus DC-Solar 1600VA / 12 volt / 725W Solar / 440Ah battery

A simple system that combines DC Solar energy with mains backup

Introduction

How to give priority to Solar when available (assistants)

MCO: story needs to be changed so the solar bit is also in there. A simple system for mains backup combined with solar power. When mains power is available the loads are powered directly. If the mains is not available, the loads are powered with the energy from solar and the batteries. When the mains is available again the power will be supplied directly from the mains and the batteries will be charged again.

How long is the autonomy? (ie. how long can it run on batteries)


The run time on batteries depends on the power consumption. If the power consumption is high like during the day then time available will be short. During the night when power consumption is low, it will be the other way around. The runtime below is calculated without and with solar power available to give a general idea.

Average load	Run time	
	No Solar	With Solar about 400W
100 W	24 Hours	more then 24 hours
800 W	2.5 Hours	5 hours

Note that these times are calculated to discharge the battery to 50%, which is the recommended maximum for GEL and AGM batteries.

Parts

- 1x - CMP121620000 - [MultiPlus Compact 12/1600/70-16 230V VE.Bus Inverter/Charger](#)
- 1x - SCC010050200 - [BlueSolar MPPT 100/50 \(12/24V-50A\)](#)
- 1x - BAM010700000 - [Battery Monitor BMV700](#)
- 2x - BAT412201080 - [12V/220Ah AGM Deep Cycle Battery](#)
- 2x - Battery link cables
- Solar panels - [Solar panel information](#)

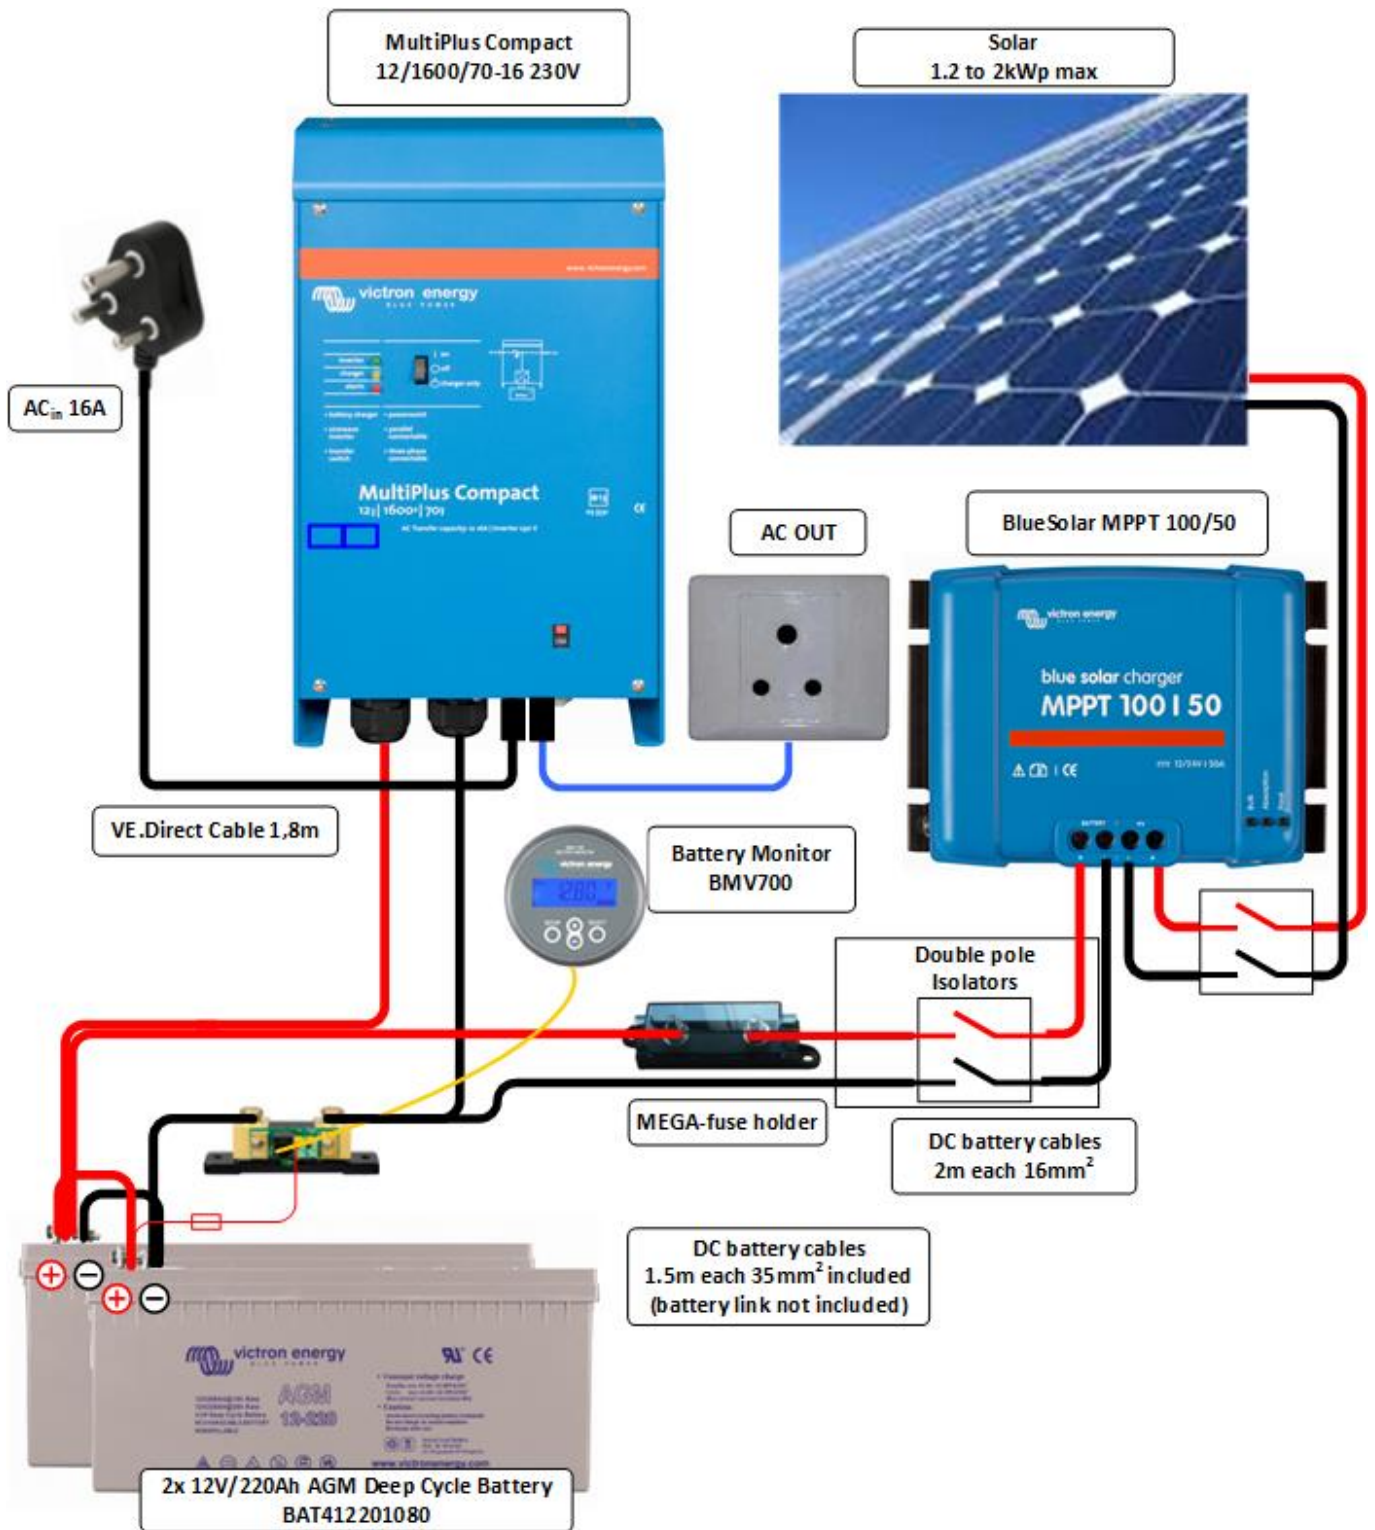

Notes for batteries

- We recommend using deep-cycle GEL or AGM batteries. At least 200Ah blocks.
- Cable cross section: The Multiplus 1600 comes with 35mm² battery cables of 1.5m included. If longer cables are needed, a cable with a thicker cross section may be needed. Check the table in this document: [For more information on battery cables](#)

Optional extra 1: Simple monitoring


For simple monitoring and remote on/off switching the Digital Multi Control can be used. This is installed using 1 RJ45 UTP network cable. The panel can be used to turn the Multi on and off, though we advice to disable this in a software setting to prevent accidental switch-offs, and to see the operational state, including a low battery alarm.

- DMC000200000R - [Digital Multi Control 200/200A GX](#)
- ASS030066xxx - [RJ45 UTP network cable, available from 0.3 to 30m](#)

Optional extra 2: Advanced monitoring

If you want to do more advanced monitoring or even logging and remote monitoring via Internet, you can install the Color Control GX. This is a graphical display which can connect to almost all Victron equipment and the internet. For more information and details see the product pages.

- BPP000300100R - [Color Control GX](#)
- ASS030066xxx - RJ45 UTP network cable, available from 0.3 to 30m.
- ASS030530xxx - Straight VE.Direct cables, available from 0.3 to 10m.
- ASS030531xxx - VE.Direct cables with an angled connector on one side, to minimize required depth behind a panel, available from 0.3 to 10m.

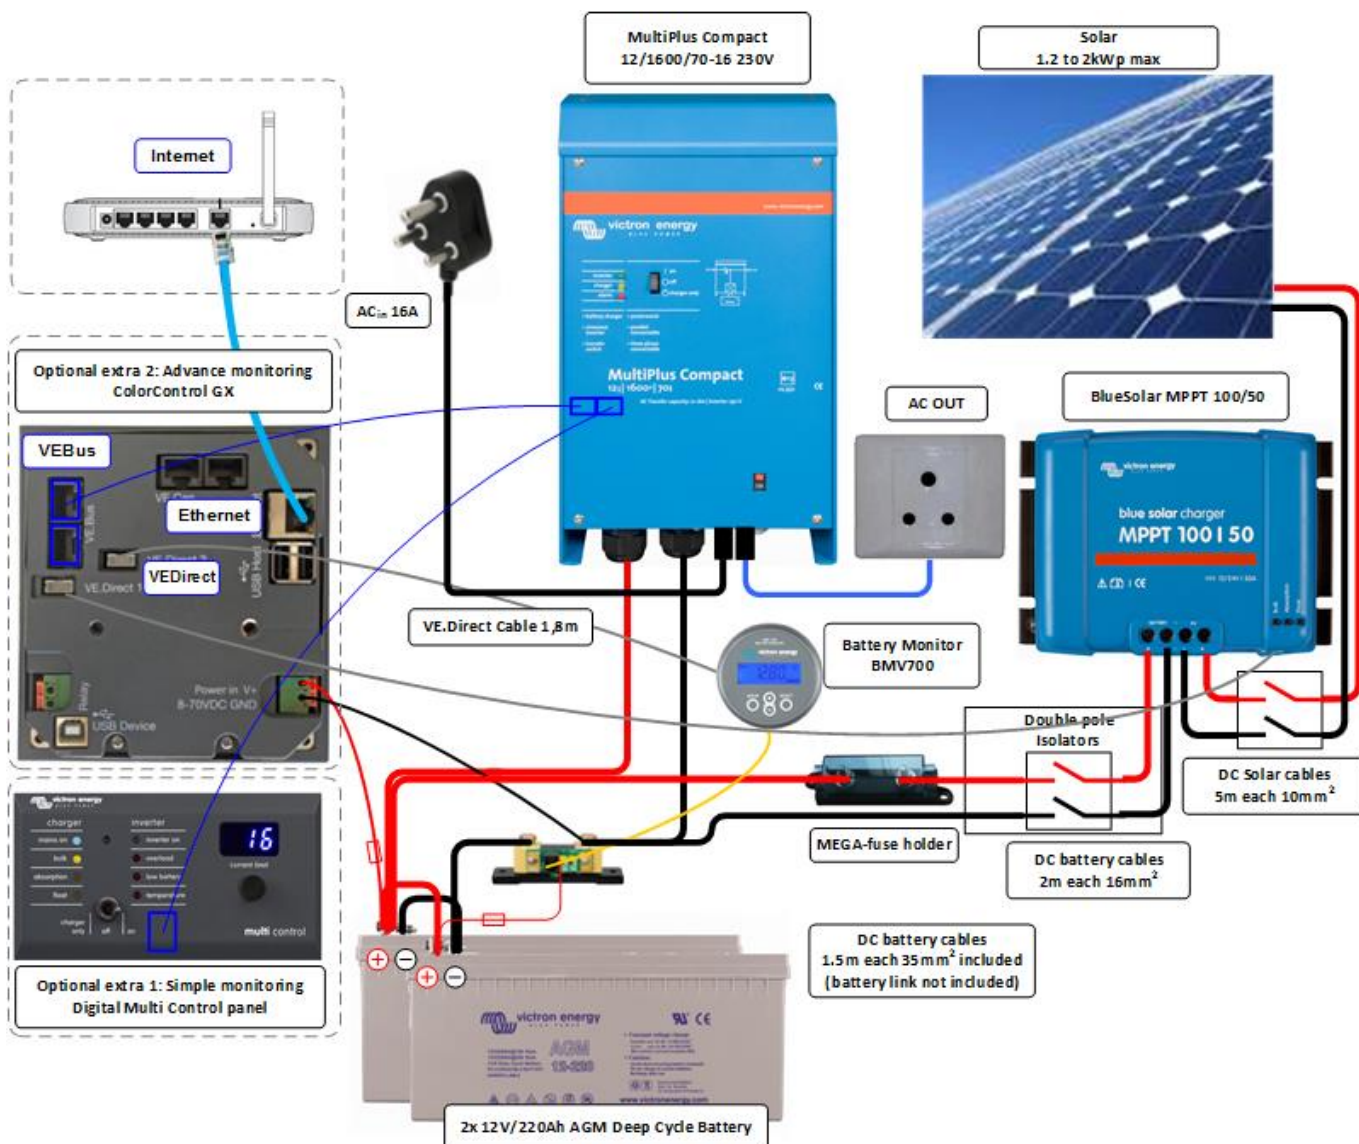

Installation

- Connect the AC output to the loads you want to backup
- Connect the battery cables to the battery. Read the manual for details on how to safely connect the batteries. Put the batteries not outside, in the shade, cooled, not under the MultiPlus, in a ventilated area and the terminals are covered but there is enough space to work on them with ease. Follow the Quick install guide that is supplied with the manual – available for download at [Quick installation guide](#) Best practises for an UPS/Back-up power supply installation must be followed according to local regulations.
- Connect the AC input to the mains.

Software configuration

For the system to work correctly some default settings need to be changed using the program VEConfigure3. This can be dowloaded from our website. On our website there is also documentation avaiable that explains how VEConfigure should be used.

- [software download VEConfigure](#)

- [A guide to VEConfigure](#)
- [Updating VE.Bus products](#)

To connect the Multi to a PC or laptop a MK2-USB interface is needed. For more information: [MK2-USB interface](#)




Settings


Only a few settings need to be changed. See the list below. Some screenshots are displayed to help you if you are a first time user.


- Disable overrule by remote → General tab
- Change DC input low shutdown to 10.8 volts → Inverter tab
- Change DC input low restart to 11.8 volts → Inverter tab
- Change DC input low pre-alarm to 11.8 volts → Inverter tab
- Charge current can be left at standard setting → Charger tab
- Enable battery monitor and set correct Battery capacity → Battery monitor tab (only needed with ColorControl GX option).

General tab

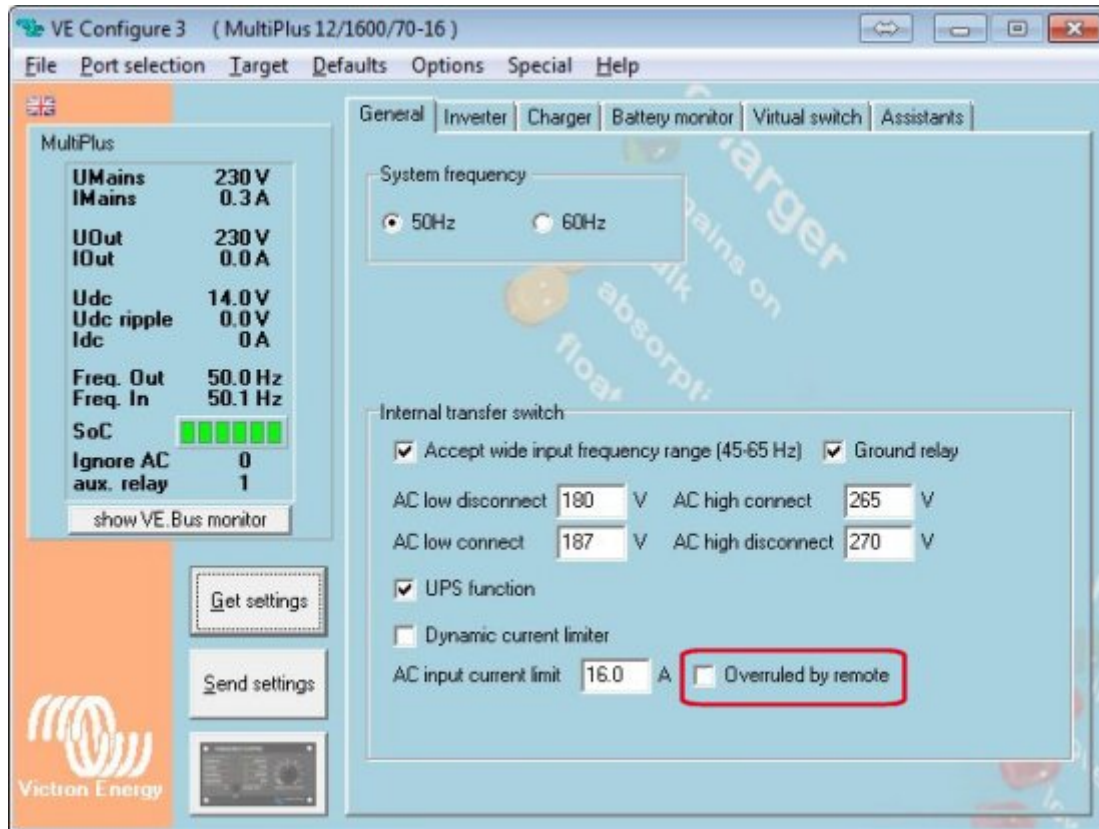

Battery monitor tab and Inverter tab

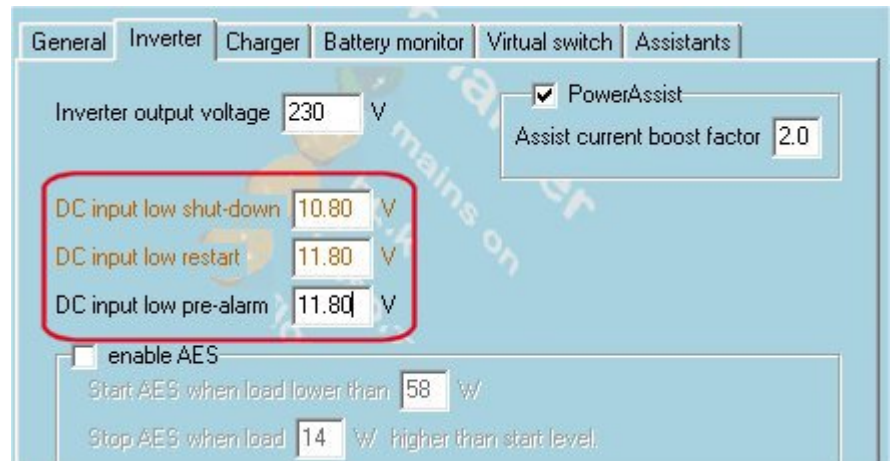

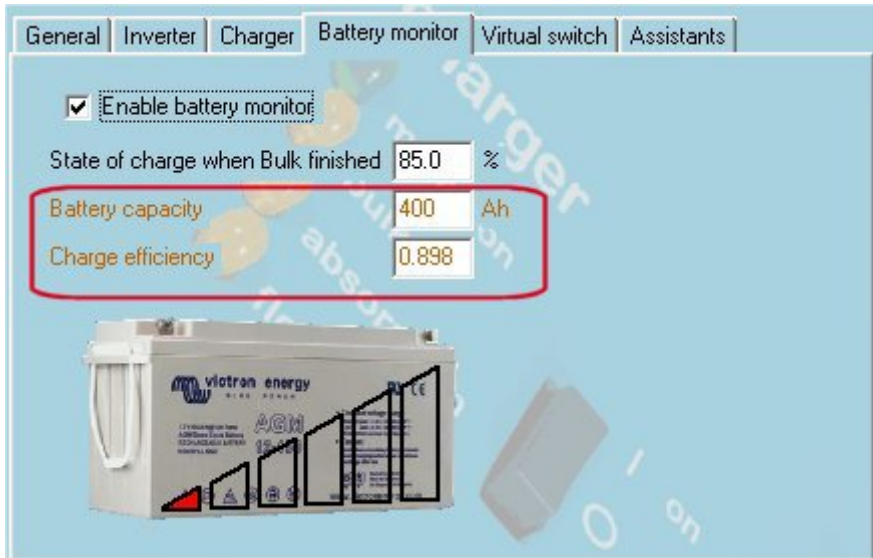

DISQUS Comments

~~DISQUS~~

From:
<https://www.victronenergy.com/live/> - **Victron Energy**

Permanent link:
https://www.victronenergy.com/live/drafts:sa_system:dc solar1600-mp?rev=1429185349

Last update: **2015-04-16 13:55**

